




DUCTILE IRON PIPE BEDDING & BACKFILL DETAIL

Created: June 6, 2012

Revised: January 24, 2017

Scale: N.T.S.

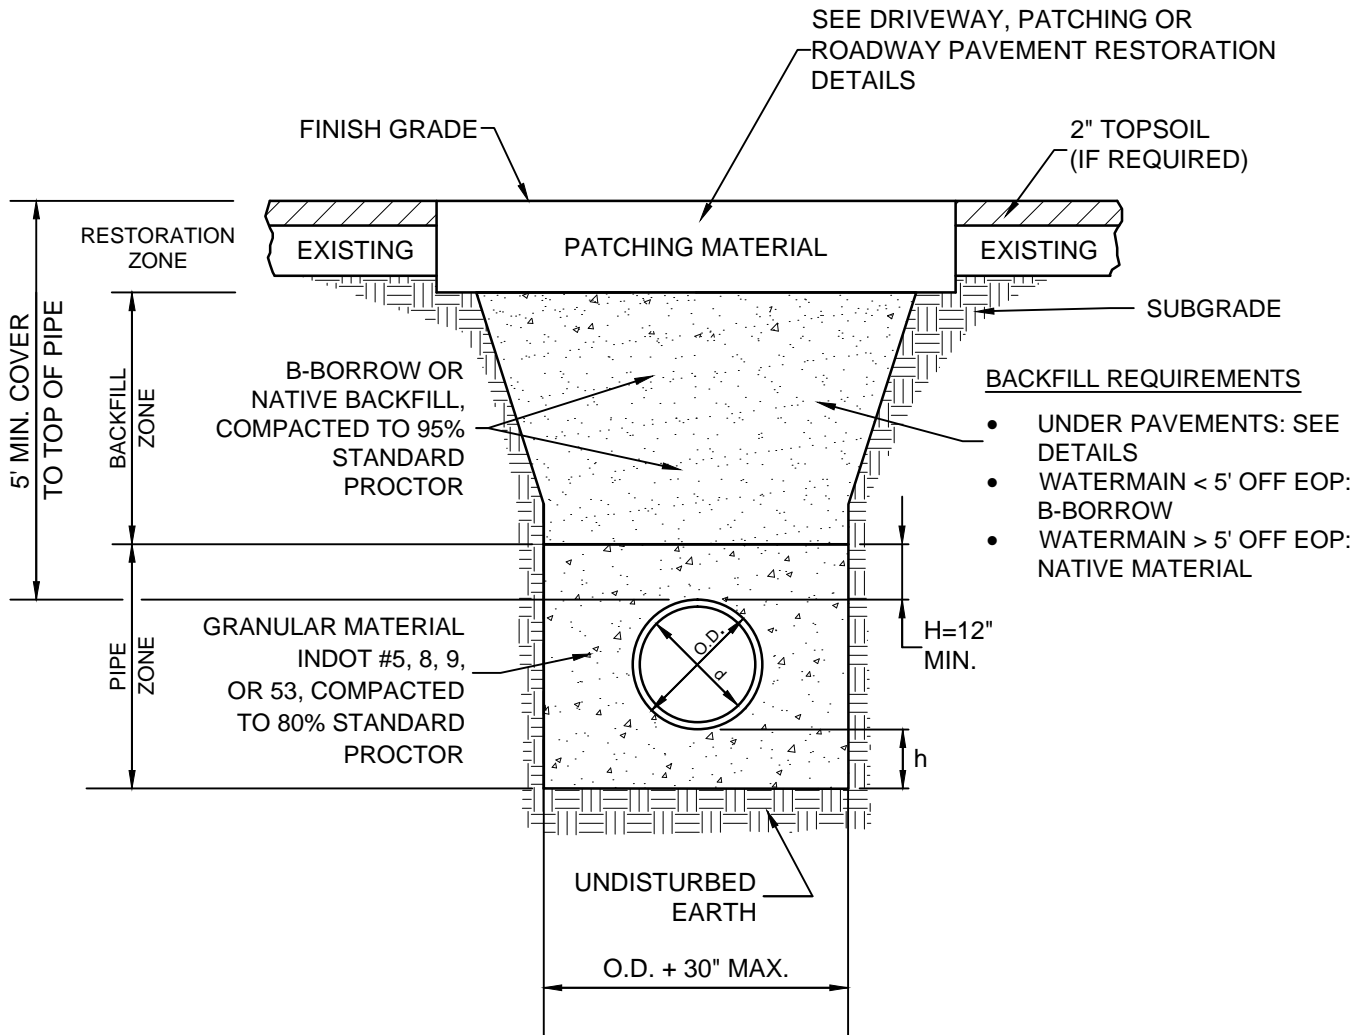

BACKFILL REQUIREMENTS

- UNDER PAVEMENTS: SEE DETAILS
- WATERMAIN < 5' OFF EOP: B-BORROW
- WATERMAIN > 5' OFF EOP: NATIVE MATERIAL

Legend:

- O.D.= Outside Diameter
- H= Backfill Cover Above Top of Pipe
- d= Inside Diameter
- h= $\frac{O.D.}{8}$; 4" Minimum

Note:

- For Rock or Other Non-Compressive Material: The Trench Should be Over- Excavated a Minimum of 6" and Refilled with