




# FIRE HYDRANT ASSEMBLY TYPE IV

Created: January 1, 2002

Revised: October 30, 2015

Scale: N.T.S.

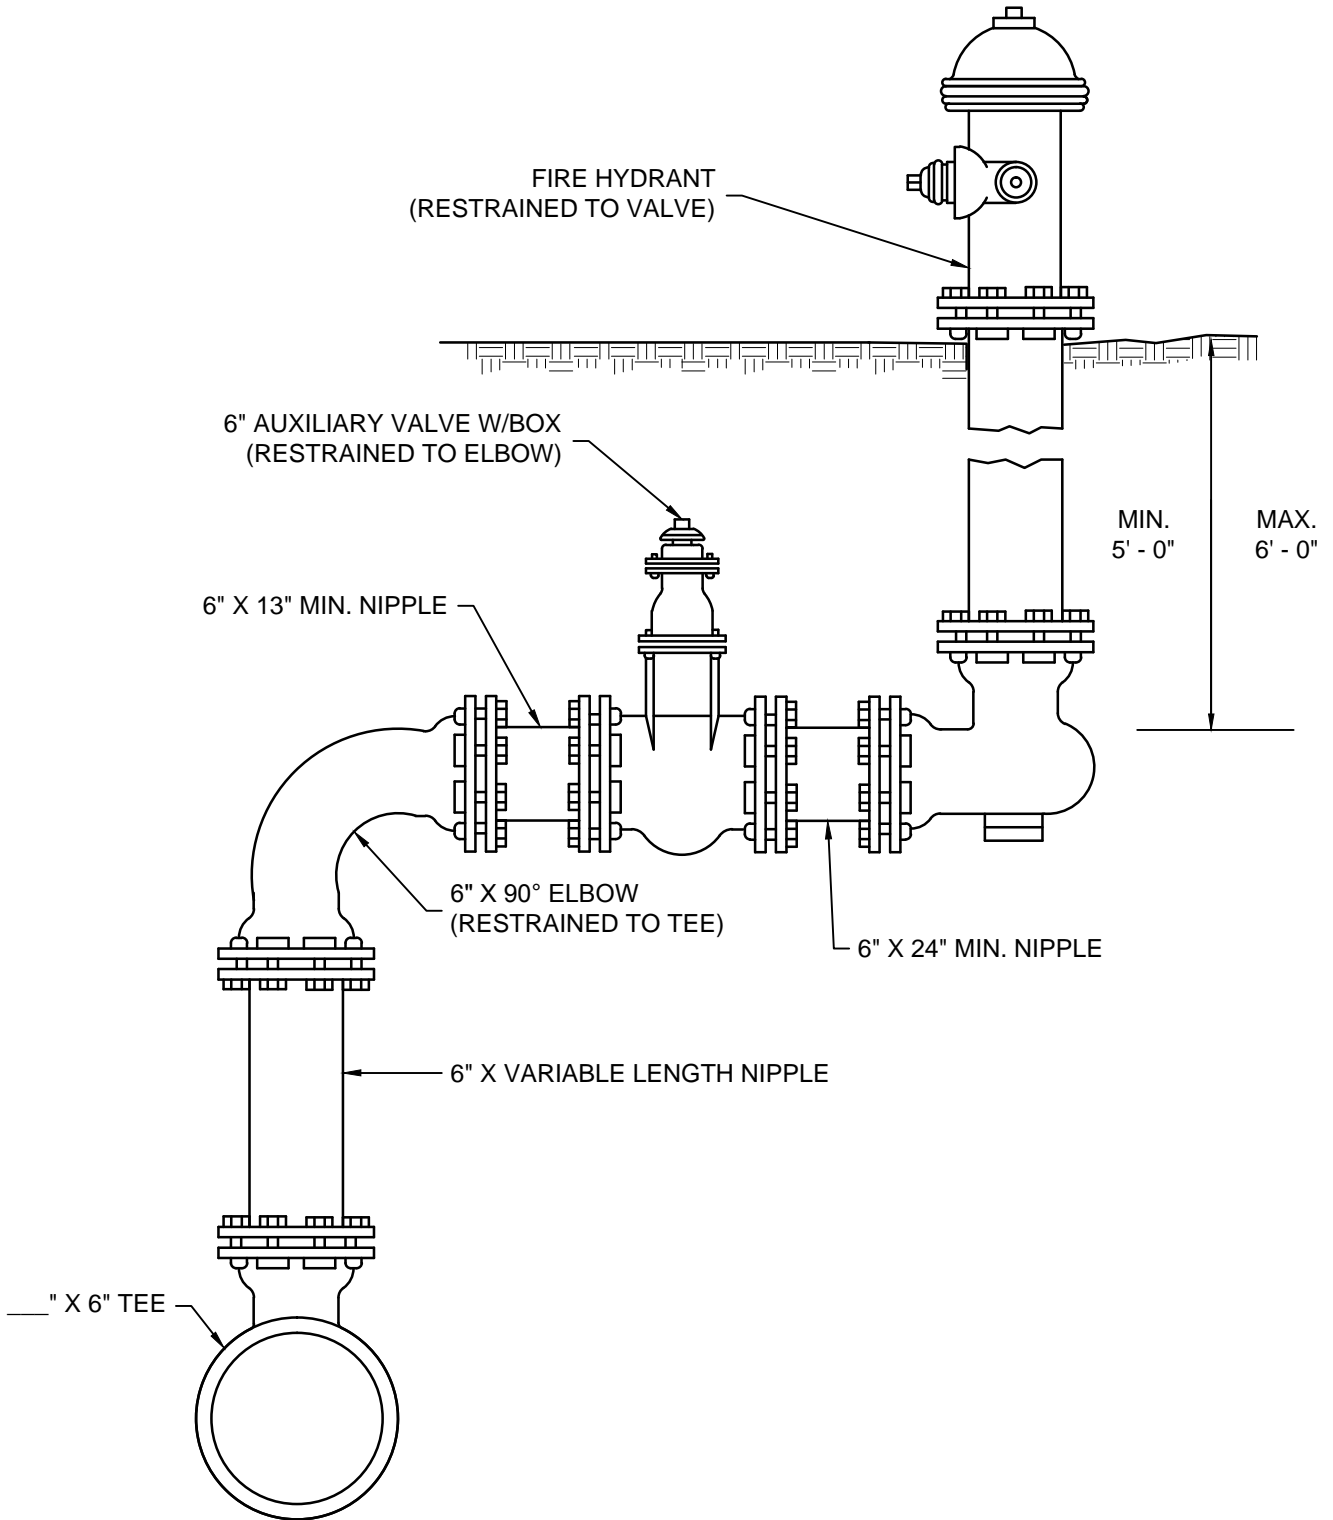

**NOTES:**

**FIRE HYDRANT ASSEMBLY TYPE IV**

1. THIS ARRANGEMENT CAN BE USED ON ALL SIZES OF WATER MAINS.
2. ANY SUBGRADE DISTURBED BENEATH FIRE HYDRANTS SHALL BE THOROUGHLY COMPACTED OR OTHER SUITABLE MATERIAL SHALL BE FURNISHED, PLACED, AND COMPACTED TO PROVIDE A FIRM FOUNDATION FOR HYDRANT.
3. FIRE HYDRANTS SHALL BE INSTALLED PER "STANDARD FIRE HYDRANT SETTING" DETAIL.
4. ALL PIPING FROM TEE TO HYDRANT SHALL BE RESTRAINED.