


INTERIOR SECTION

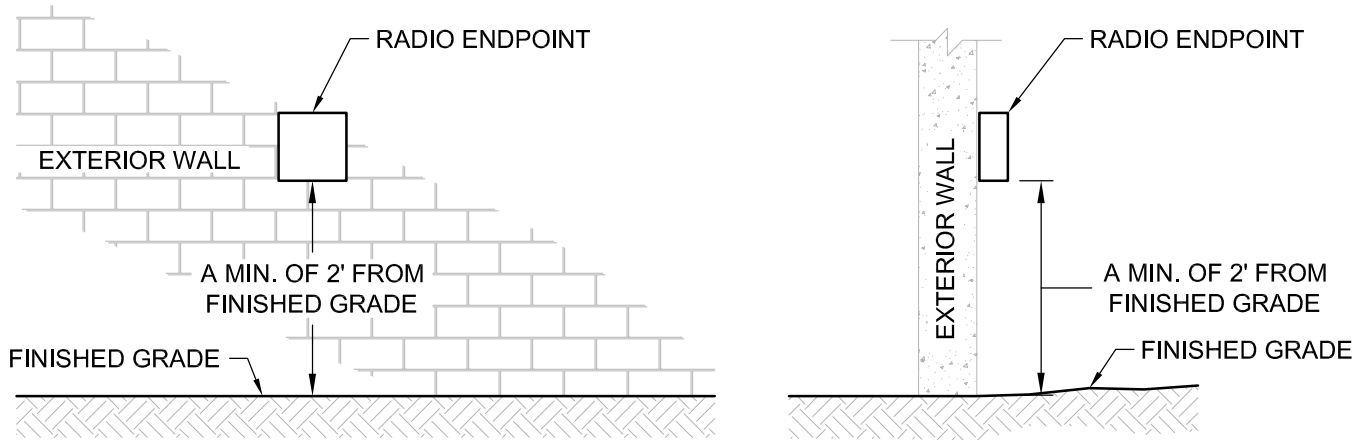

WATER METER RADIO ENDPOINT

NOTES:

1. THE WIRE SHALL BE UL TYPE CL2 75C 3-WIRE, 22-26 GAUGE, SOLID DIAMETER, MAX DIAMETER 0.082".
2. THE WIRE SHALL BE INSTALLED FROM THE METER SET TO THE EXTERIOR OF THE BUILDING. THE WIRE SHALL BE LOCATED ON THE SIDE OR FRONT OF THE BUILDING. THE WIRE SHALL NOT BE INSTALLED ON THE BACK SIDE OF THE BUILDING. THE UTILITY DESIRES THAT THE WIRE BE LOCATED WHEN ABLE WITH OTHER OUTSIDE UTILITIES (POWER METER AND GAS METER).
3. THERE SHALL BE THREE (3) FEET OF EXCESS WIRE AVAILABLE AT BOTH THE METER SET AND THE RADIO ENDPOINT LOCATION ON THE OUTSIDE OF THE BUILDING.
4. THE WIRE SHALL HAVE A LABEL WITH "WATER METER" WRITTEN ON IT AND ATTACHED TO THE WIRE END ON THE INSIDE AND OUTSIDE WIRE.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE WIRE PASSING A CONDUCTIVITY TEST.