


STRAIGHT CONNECTION

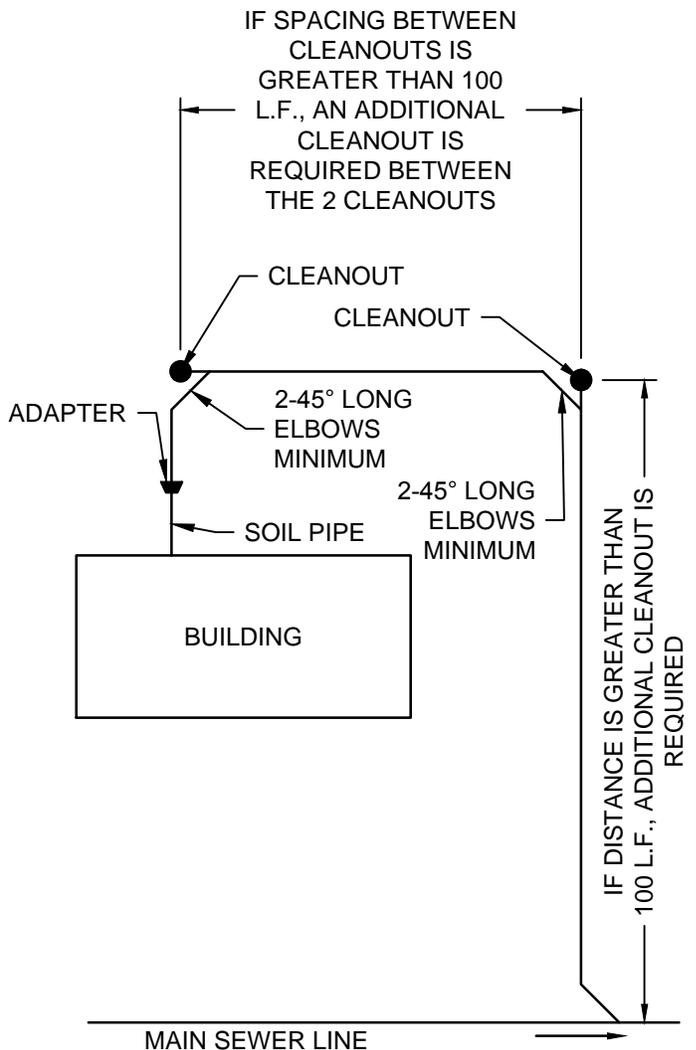

AROUND THE BUILDING CONNECTION

NOTES:

1. MAXIMUM DISTANCE BETWEEN THE EXTERIOR WALL AND THE CLEANOUT WYE SHALL BE 7'.
2. NO 90° ELBOW IS PERMITTED IN BUILDING SEWER. TWO 45° LONG ELBOWS MUST BE USED.
3. MINIMUM SLOPE OF BUILDING SEWER SHALL BE 2% (1/4" PER FOOT).
4. MINIMUM SIZE FOR BUILDING SEWER SHALL BE 6" IN DIAMETER.
5. BUILDING SEWER LINE SHALL BE INSPECTED AND APPROVED BEFORE EXCAVATION IS BACKFILLED.
6. NO CLEANOUT CAN BE INSTALLED IN A ROAD OR ALLEY RIGHT-OF-WAY OR IN A DEDICATED EASEMENT UNLESS OTHERWISE APPROVED BY THE GOVERNING AGENCY OR DEPARTMENT.