


City Utilities Design Standards Manual


## 1500 GALLON PRECAST GREASE INTERCEPTOR

Created: September 6, 2011 Revised: May 19, 2015

Scale: N.T.S. Approved: May 19, 2015

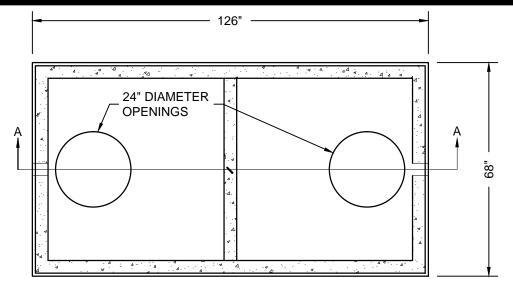

## **TOP VIEW**

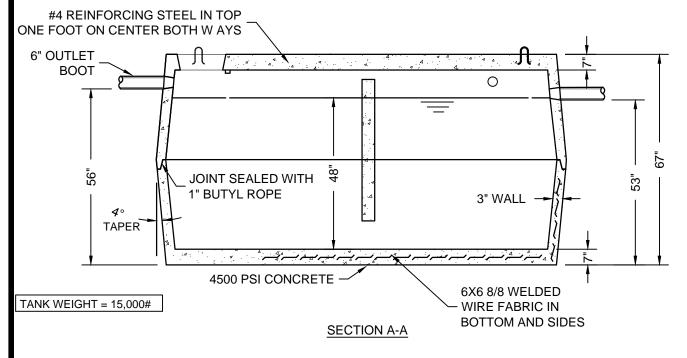

## NOTES:

- 1. RISER RINGS SHOULD BE ORDERED TO GRADE.
- MINIMUM 4500 PSI AT 28 DAYS CONCRETE.
- 3. REINFORCING BARS SHALL CONFORM TO ASTM A-615 GRADE 60 STEEL.
- 4. ALL REINFORCING BARS SHALL BE CUT AND FORMED TO THE DIMENSIONAL TOLERANCES SPECIFIED IN ACI-315 OR ACI-318 EXCEPT WHERE NOTED ON DRAWINGS.
- 5. ALL BARS SHALL BE BENT COLD. BARS WITH KINKS AND BENDS NOT INDICATED SHALL NOT BE USED. HEATING AND REBENDING OF BARS IS NOT PERMITTED.
- 6. REINFORCING STEEL SHALL BE #4 REBAR AT 12" O.C. ONE WAY OR 6X6 10/10 WELDED WIRE MESH.
- 7. EARTH COVER: 6" MINIMUM UP TO 3'-0" MAXIMUM. SIZE PAD ACCORDING TO AMOUNT OF EARTH COVER.