



FIELD-CREATED 33" ROUND INLET


Created: July 21, 2010

Revised: July 29, 2014

Scale: N.T.S.

Approved: May 16, 2012


NOTE:
APPROVAL FROM CITY'S
PROJECT
CONTACT AND/OR PROJECT
ENGINEER MUST BE ACQUIRED
BEFORE USING THIS
STRUCTURE.

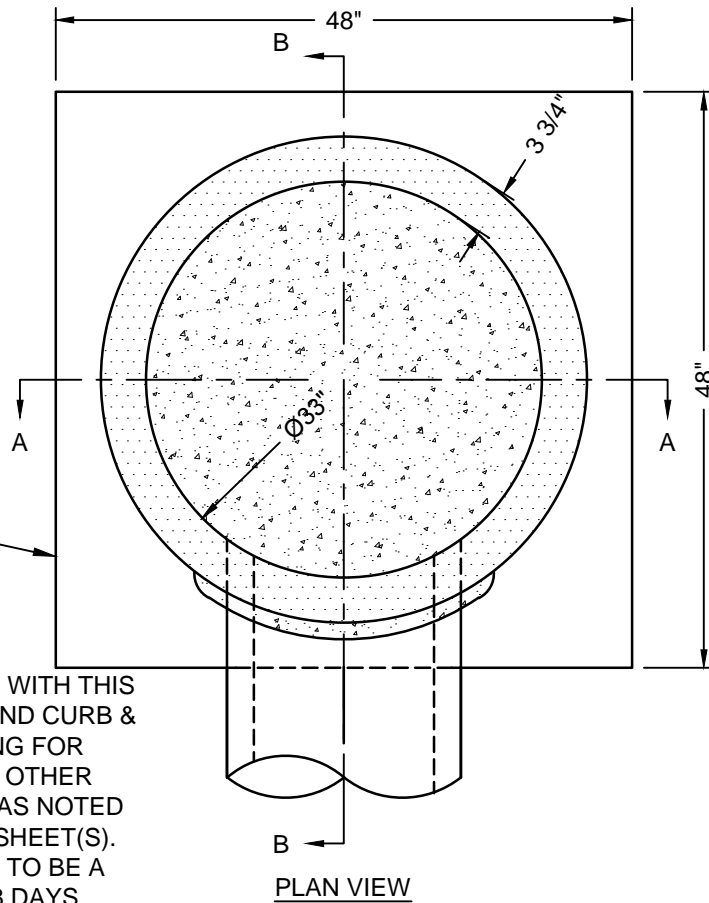


NOTES:

1. THE CASTING TO BE USED WITH THIS INLET SHALL BE A 33" ROUND CURB & GUTTER W/ADJUSTING RING FOR SUPPORT OF CASTING OR OTHER PRE-APPROVED CASTING AS NOTED ON THE PROJECT DETAIL SHEET(S).
2. ALL PRE-CAST CONCRETE TO BE A MINIMUM OF 4500 PSI @ 28 DAYS
3. REINFORCING IN CONCRETE BASE SHALL BE 6X6 - 10 GAUGE STEEL MESH

PRE-CAST REINFORCED
CONC. PIPE SECTION
CLASS III

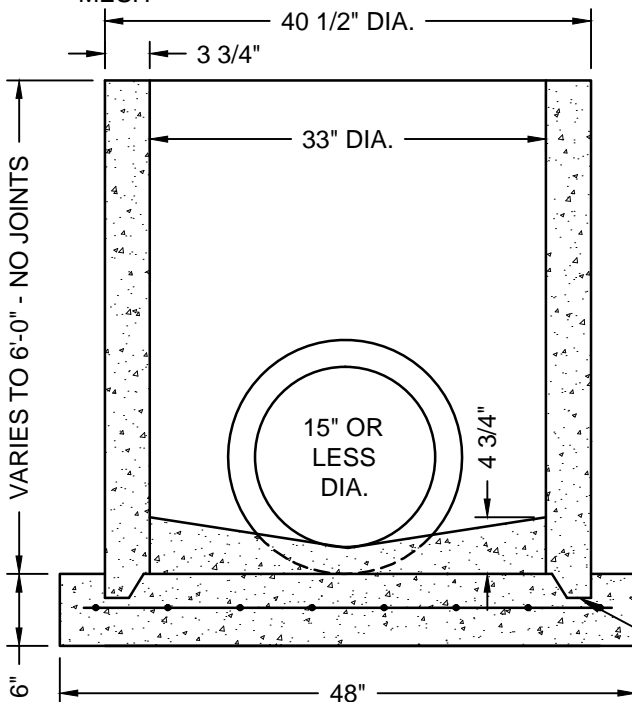

SECTION A-A

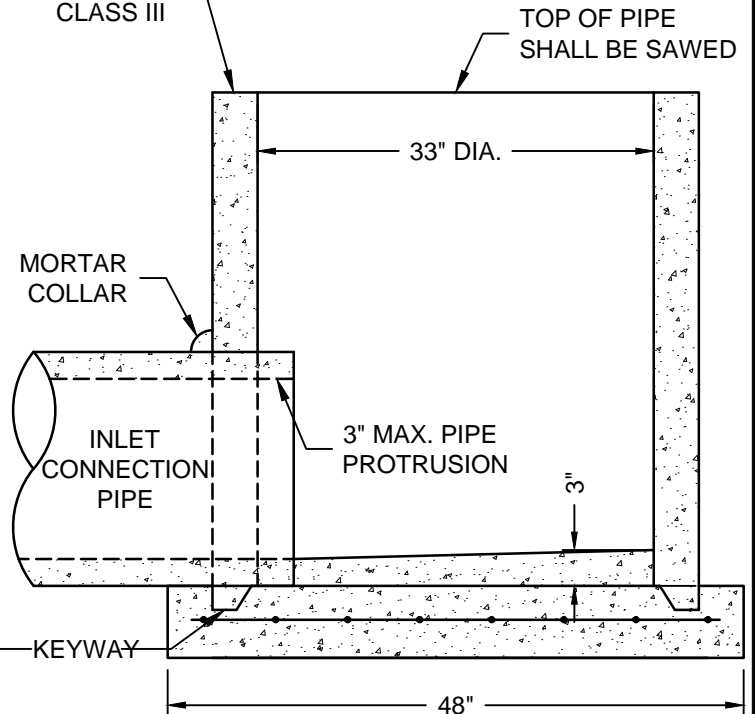

SECTION B-B