




FIRE HYDRANT ASSEMBLY TYPE I - HDPE

Created: January 1, 2002

Revised: August 18, 2016

Scale: N.T.S.

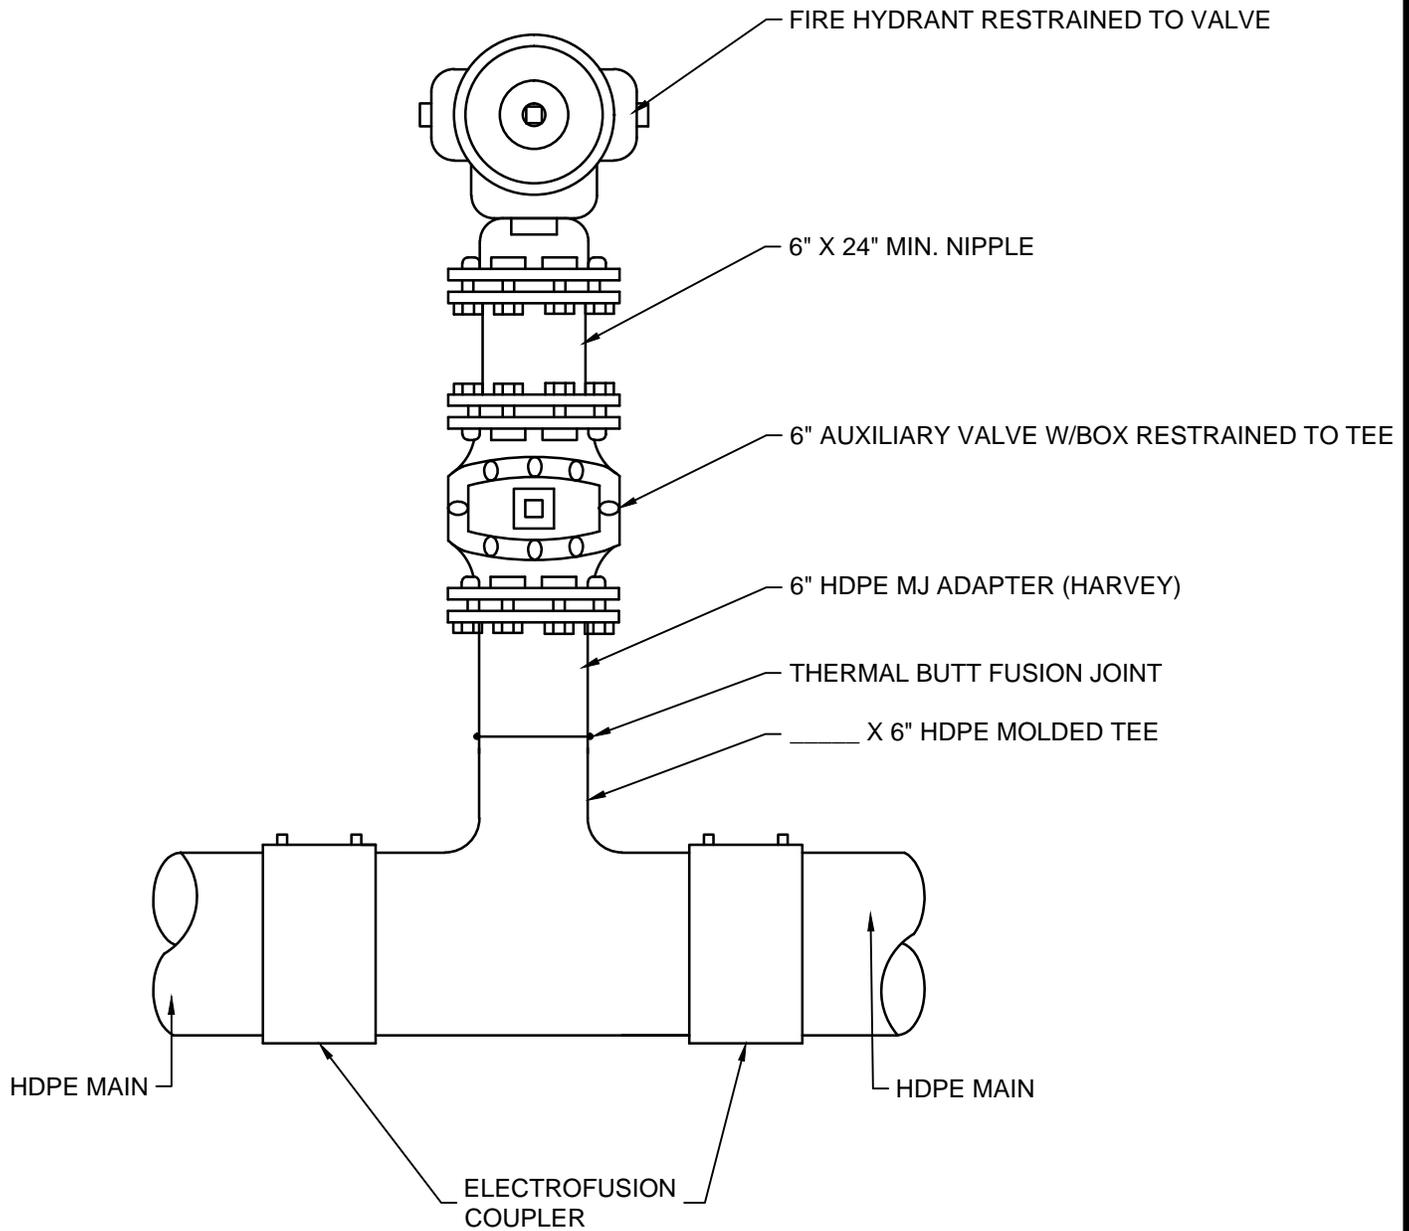

FIRE HYDRANT ASSEMBLY TYPE I

NOTES:

1. THIS ARRANGEMENT CAN BE USED ON 6" MAINS.
2. FIRE HYDRANTS SHALL BE INSTALLED PER "STANDARD FIRE HYDRANT SETTING" DETAIL.
3. LENGTH OF NIPPLES TO VARY TO MEET "GENERAL LOCATION OF FIRE HYDRANT" DETAIL.