




FIRE HYDRANT ASSEMBLY TYPE III MODIFIED

Created: January 1, 2002

Revised: October 30, 2015

Scale: N.T.S.

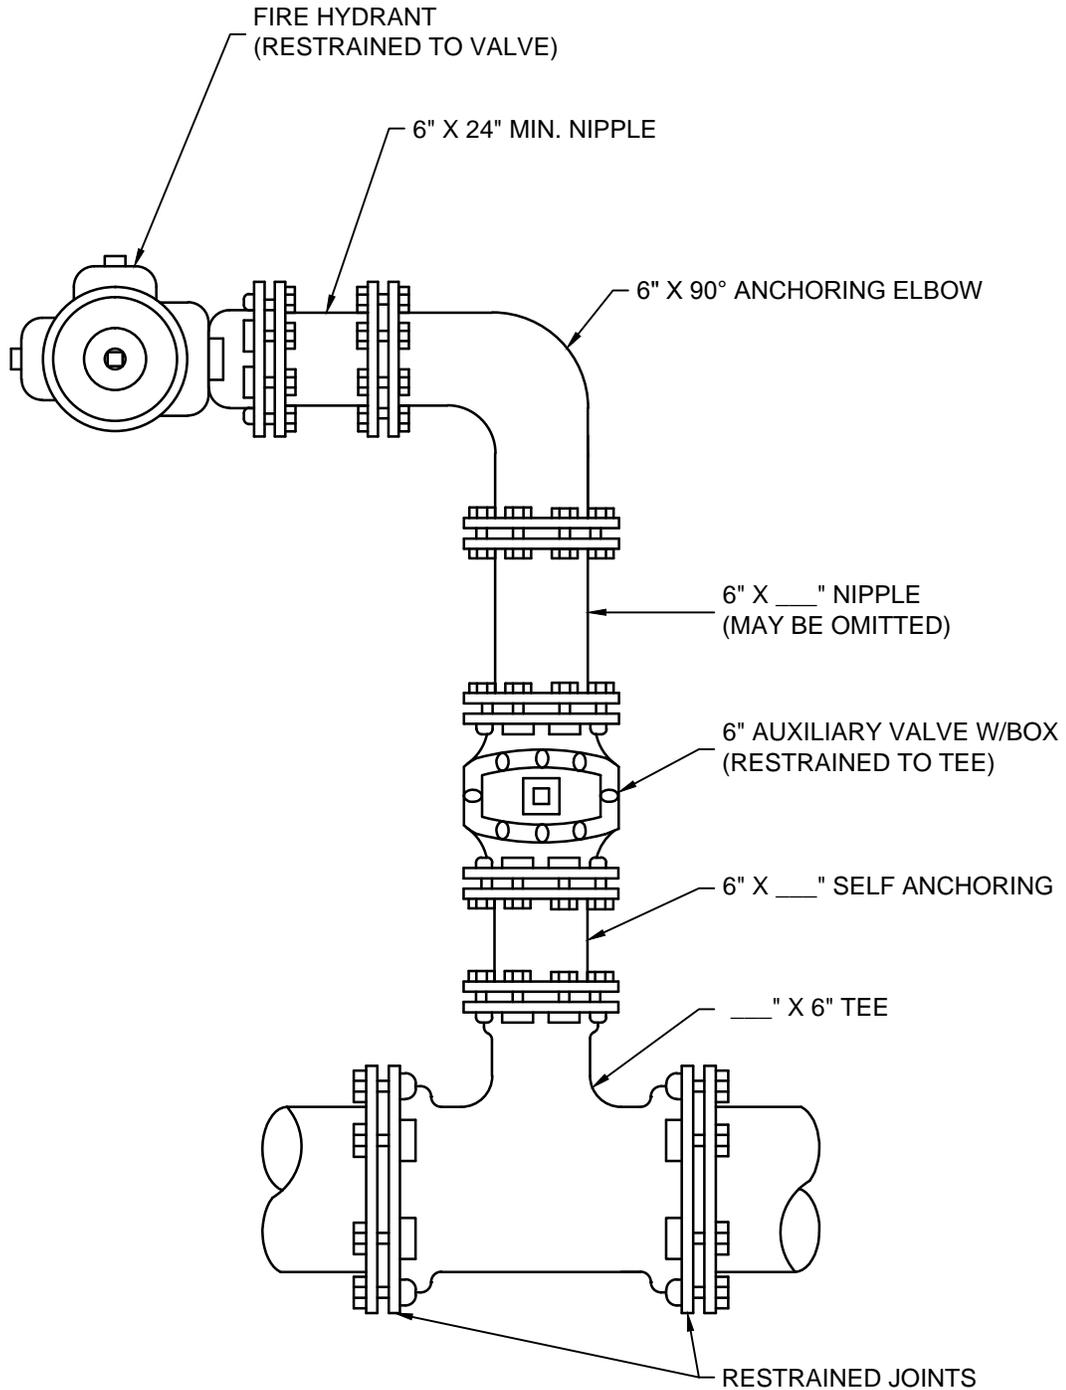

FIRE HYDRANT ASSEMBLY TYPE III MODIFIED

NOTES:

1. THIS ARRANGEMENT CAN BE USED ON ALL SIZES OF MAINS.
2. FIRE HYDRANTS SHALL BE INSTALLED PER "STANDARD FIRE HYDRANT SETTING" DETAIL.
3. LENGTH OF NIPPLES TO VARY TO MEET "GENERAL LOCATION OF FIRE HYDRANT" DETAIL.
4. ALL PIPING FROM TEE TO HYDRANT SHALL BE RESTRAINED.