




# FIRE HYDRANT ASSEMBLY TYPE IV MODIFIED

Created: January 1, 2002

Revised: October 30, 2015

Scale: N.T.S.

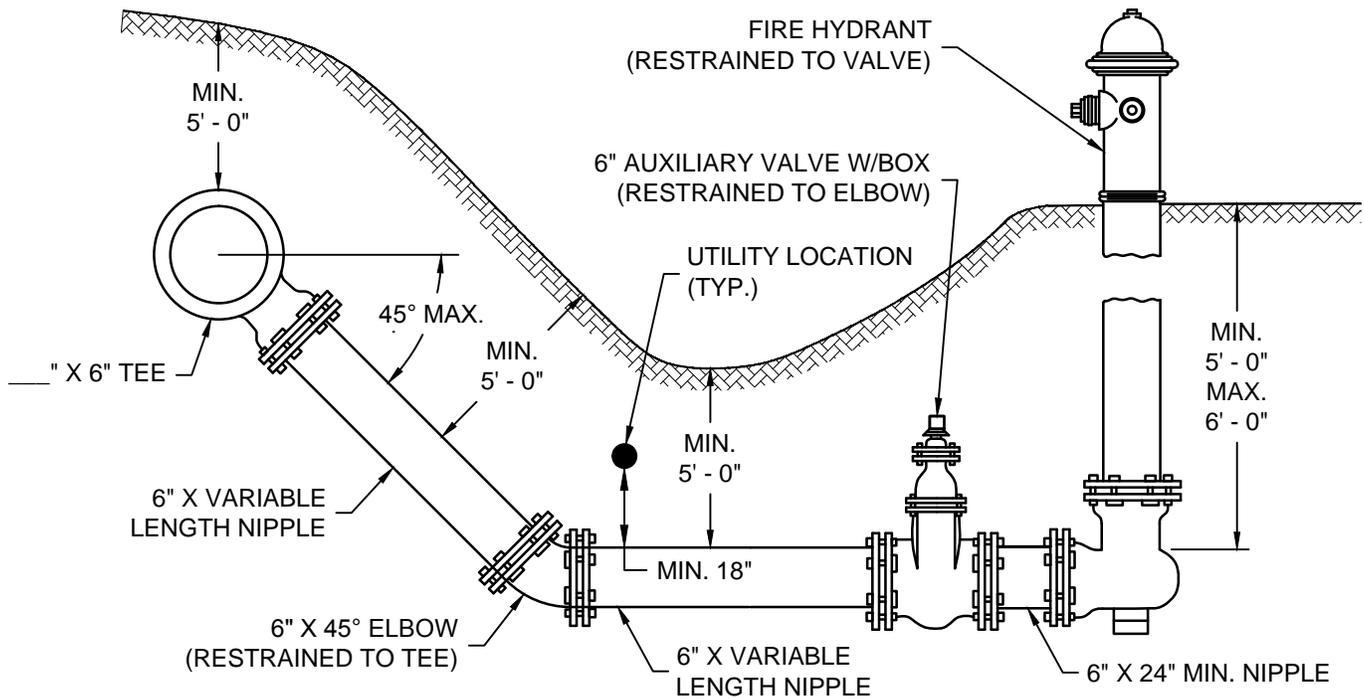

FIRE HYDRANT ASSEMBLY TYPE IV MODIFIED

**NOTES:**

1. ANY SUBGRADE DISTURBED BENEATH FIRE HYDRANTS SHALL BE THOROUGHLY COMPACTED OR OTHER SUITABLE MATERIAL SHALL BE FURNISHED, PLACED AND COMPACTED TO PROVIDE A FIRM FOUNDATION FOR HYDRANT.
2. ALL PIPING FROM TEE TO HYDRANT SHALL BE RESTRAINED.
3. INTENT OF DETAIL IS TO PROVIDE 5' OF COVER FOR HYDRANT LEAD AND/OR MAINTAIN 18" SEPARATION FROM LEAD AND OTHER UTILITIES.
4. FIRE HYDRANTS SHALL BE INSTALLED PER "STANDARD FIRE HYDRANT SETTING" DETAIL.