




# FIRE HYDRANT ASSEMBLY TYPE V - HDPE

Created: January 1, 2002

Revised: August 18, 2016

Scale: N.T.S.

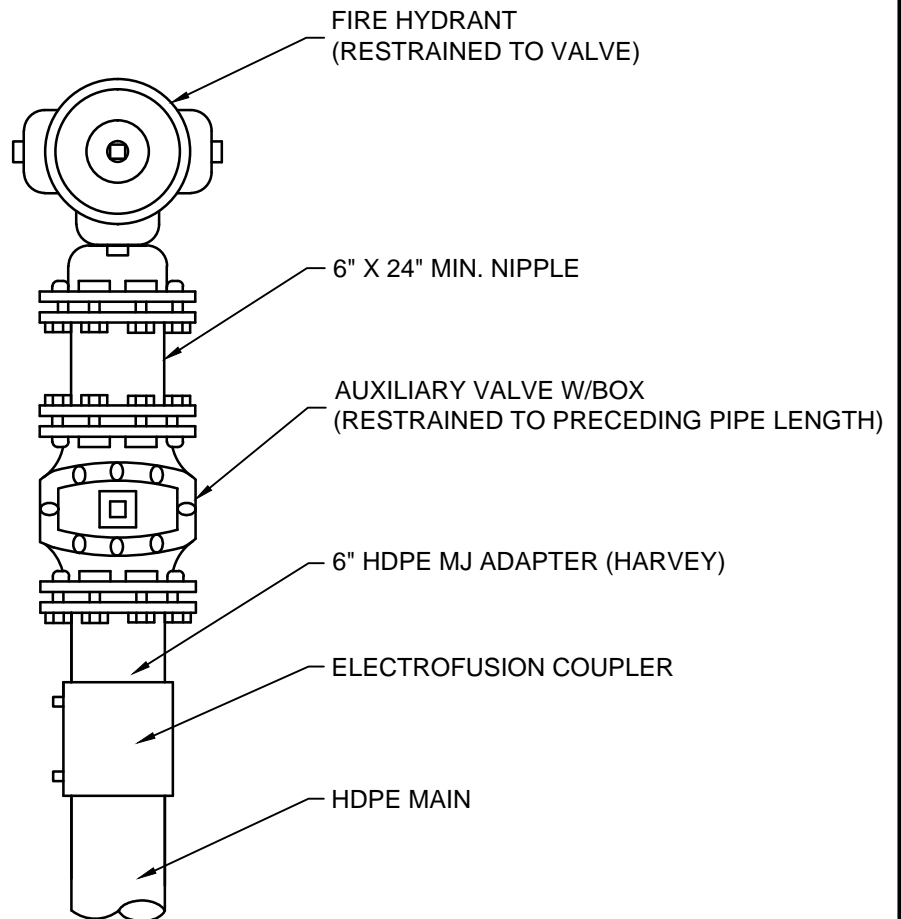

FIRE HYDRANT ASSEMBLY TYPE V- HDPE

**NOTES:**

1. ASSUME CONDITION TO BE A DEAD END FOR DETERMINING THE LENGTH OF RESTRAINED JOINTS.
2. FIRE HYDRANTS SHALL BE INSTALLED PER "STANDARD FIRE HYDRANT SETTING" DETAIL.