




FIRE HYDRANT ASSEMBLY TYPE V

Created: January 1, 2002

Revised: January 5, 2015

Scale: N.T.S.

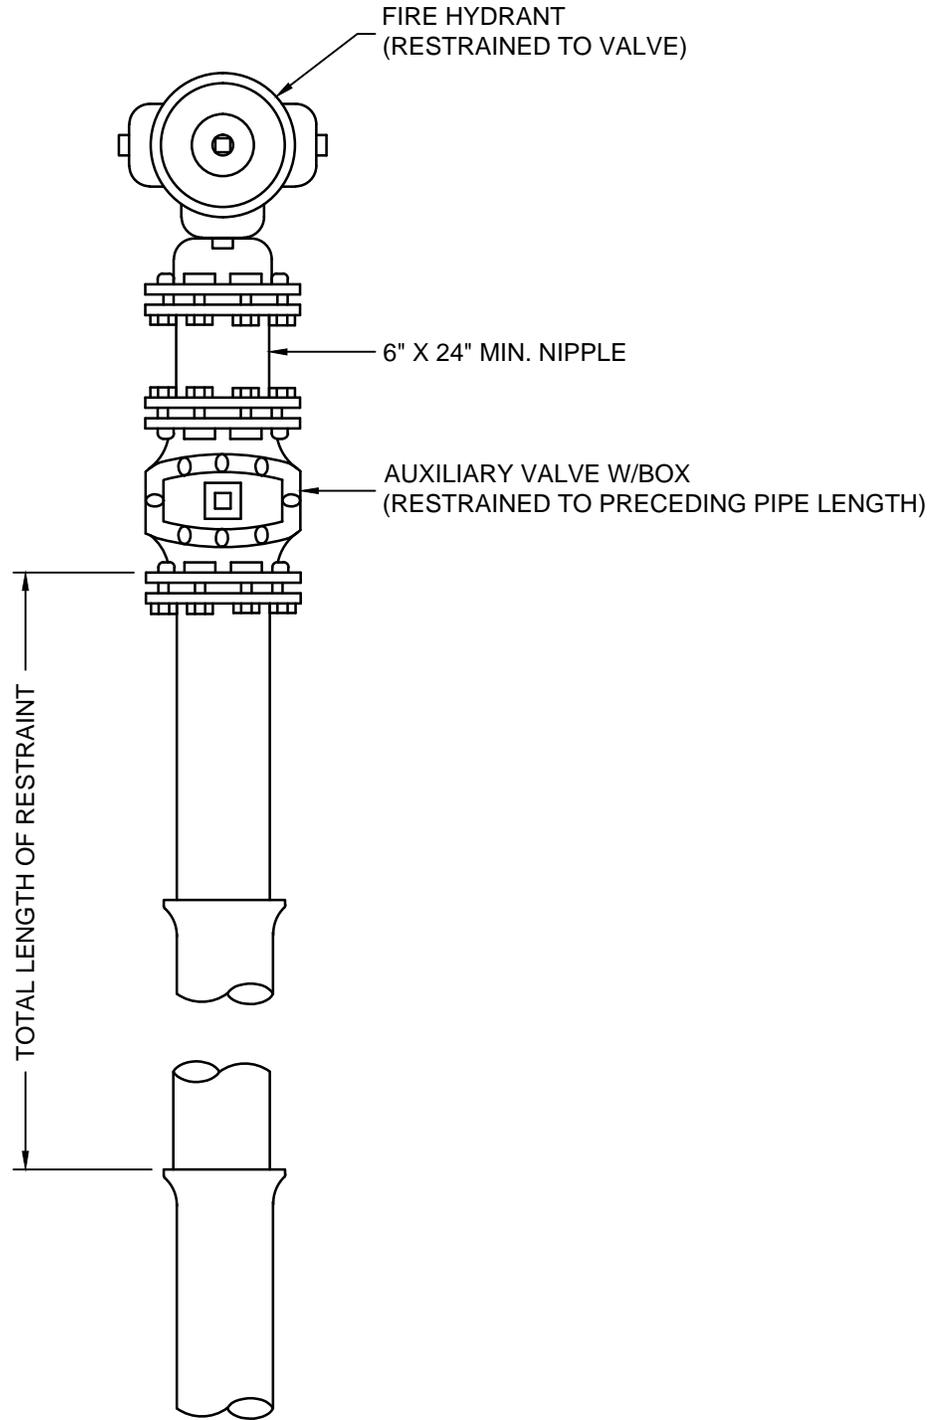

FIRE HYDRANT ASSEMBLY TYPE V

NOTES:

1. ASSUME CONDITION TO BE A DEAD END FOR DETERMINING THE LENGTH OF RESTRAINED JOINTS.
2. FIRE HYDRANTS SHALL BE INSTALLED PER "STANDARD FIRE HYDRANT SETTING" DETAIL.
3. ALL PIPING FROM TEE TO HYDRANT SHALL BE RESTRAINED.