




# STANDARD FIRE HYDRANT SETTING

Created: January 1, 2002

Revised: November 8, 2016

Scale: N.T.S.

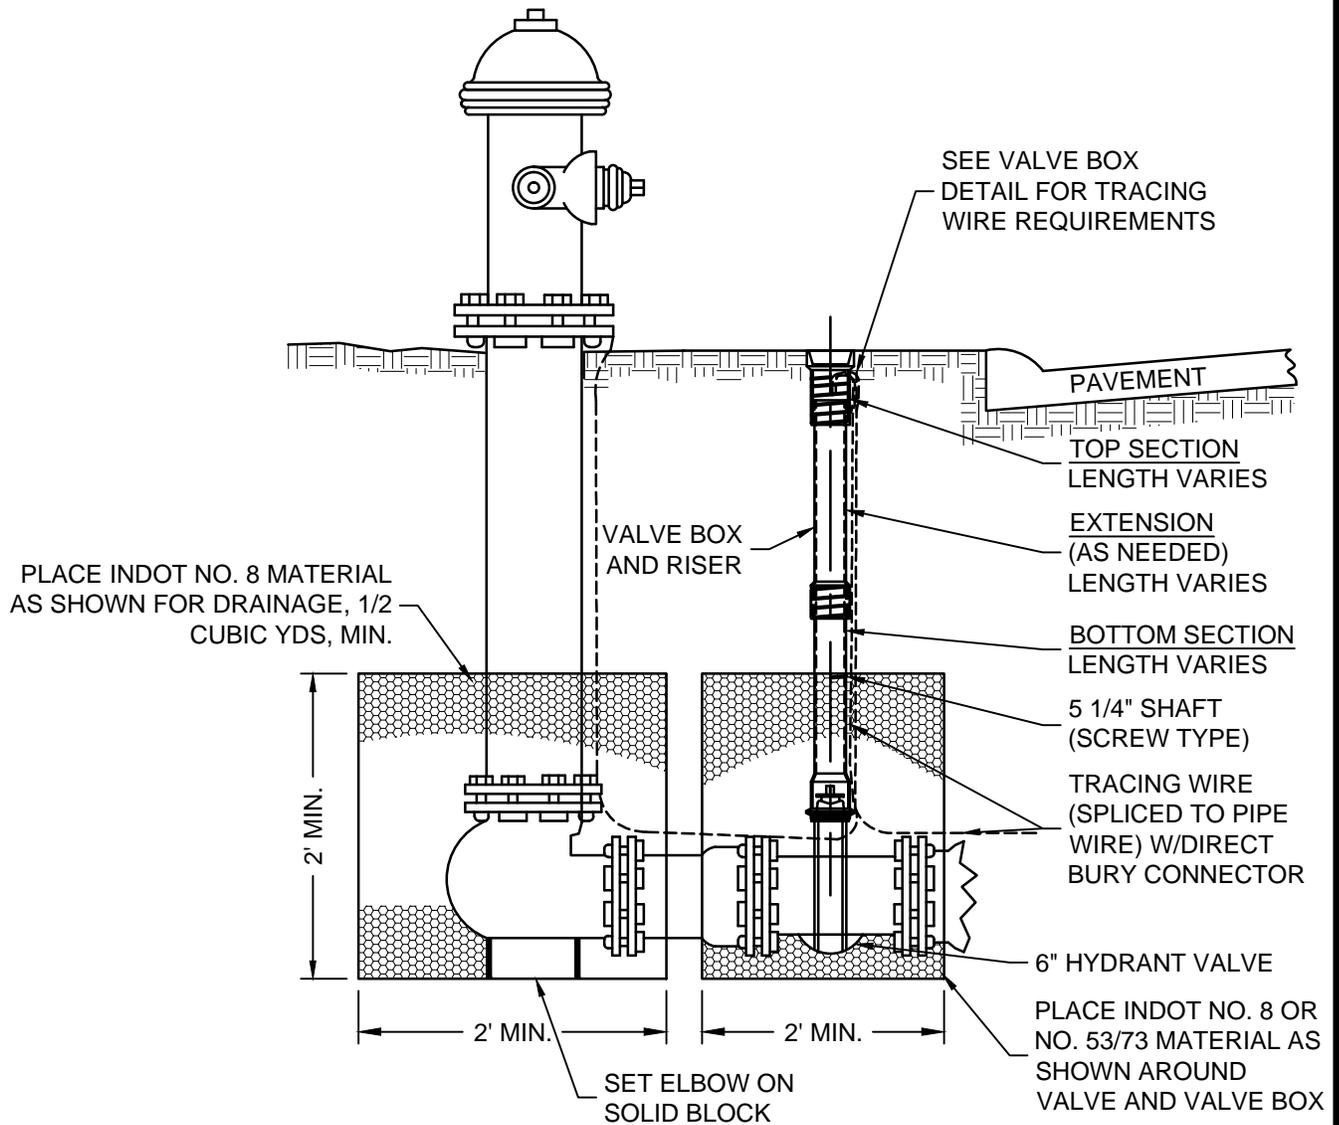

STANDARD FIRE HYDRANT SETTING

NOTES:

1. ALL HYDRANTS MUST BE RESTRAINED TO THE HYDRANT TEE.
2. TRACING WIRE REQUIRED FOR ALL PIPE.