




GENERAL LOCATION OF FIRE HYDRANT (REFERENCE TO CURB & SIDEWALK)

Created: January 1, 2002

Revised: November 10, 2016

Scale: N.T.S.

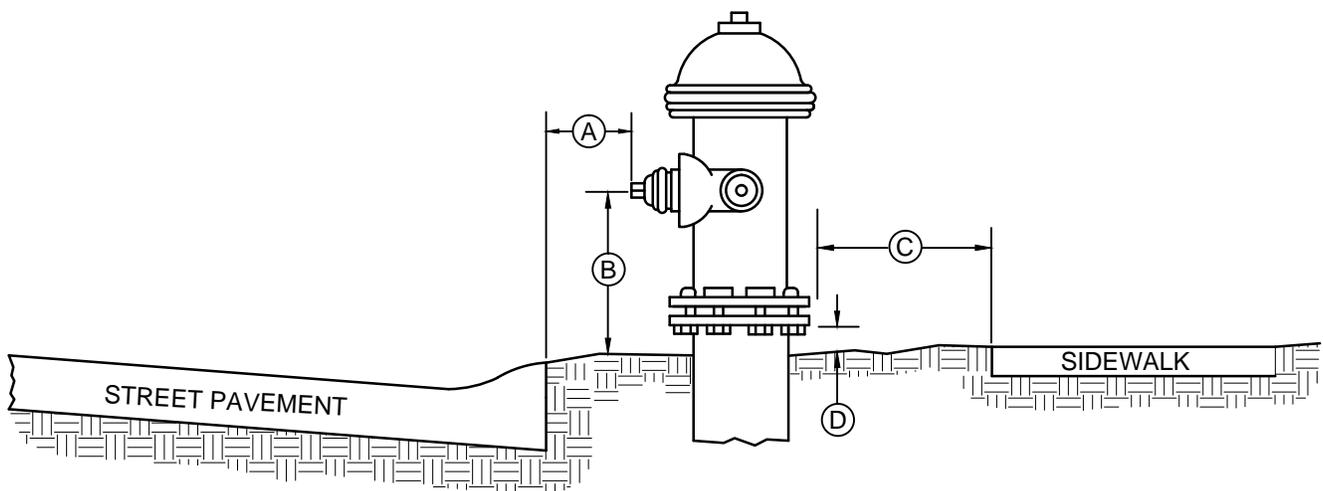

- (A) PUMPER NOZZLE MIN. 12", MAX 42" FROM BACK OF CURB & POINTED TOWARDS CURB.
- (B) PUMPER NOZZLE MIN. 12" ABOVE GROUND LINE.
- (C) NO PART OF HYDRANT LESS THAN 6" FROM SIDEWALK.
- (D) MIN. 2", MAX. 8" ABOVE GRADE TO FLANGE OR GROUND LINE MARK ON HYDRANT.

NOTES:

1. WHERE FIRE HYDRANTS MUST BE LOCATED IN A PAVED AREA, A MINIMUM OF 5' X 5' CONCRETE BLOCK-OUT WITH EXPANSION JOINTS ON ALL SIDES SHALL BE PROVIDED.
2. PUMPER NOZZLE SHALL FACE THE STREET.
3. FIRE HYDRANTS SHALL BE INSTALLED PER "STANDARD FIRE HYDRANT SETTING" DETAIL.
4. ON UNIMPROVED STREETS MINIMUM DISTANCE PUMPER NOZZLE FROM EDGE OF PAVEMENT SHOULD BE 48 INCHES. IF THIS LOCATION IS NOT FEASIBLE, SEEK ALTERNATE LOCATION APPROVAL FROM OWNER.