




TYPICAL VALVE PLACEMENT CUL-DE-SAC SETS

Created: January 1, 2002

Revised: October 30, 2015

Scale: N.T.S.

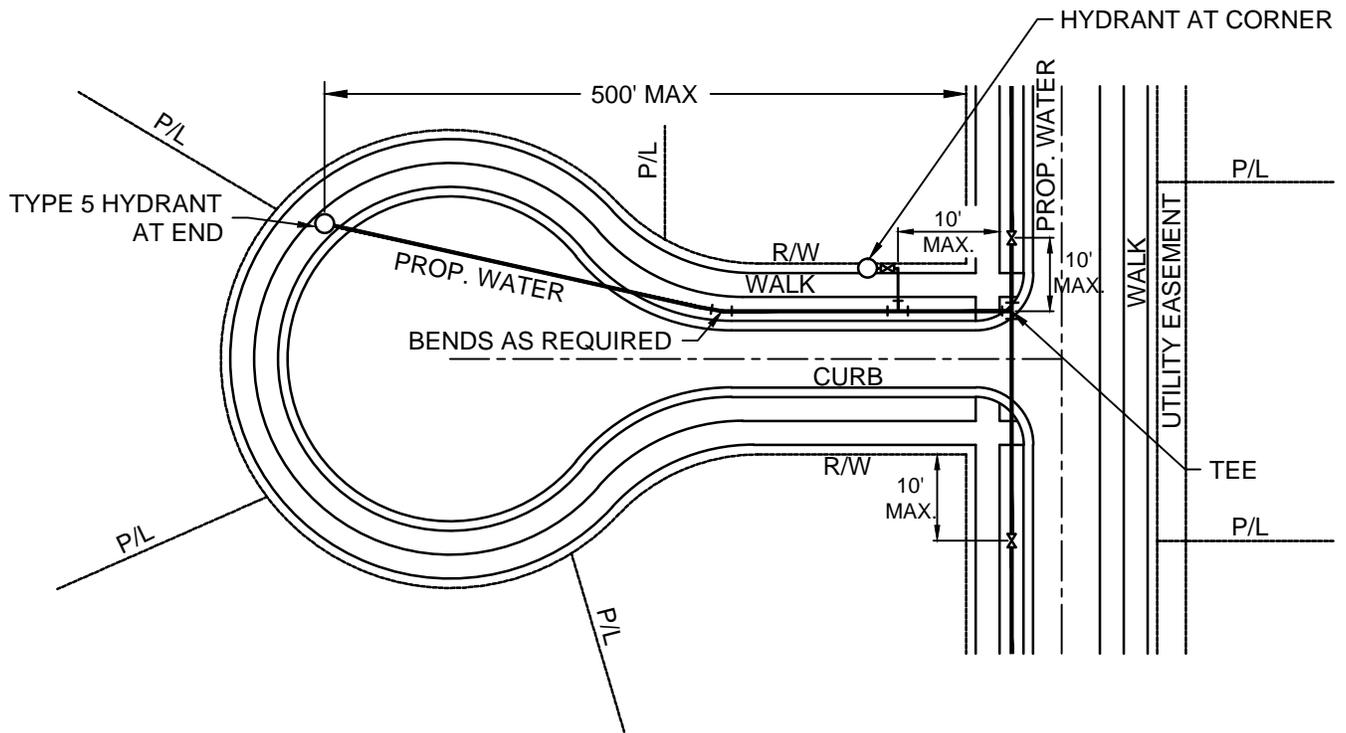

VALVE PLACEMENT ON CUL-DE-SAC

NOTES:

1. VALVES ARE NOT REQUIRED IN A CUL-DE-SAC OR DEAD END STREET WHEN THE CONNECTING MAIN IS LOOPED INTO THE DISTRIBUTION SYSTEM AS SHOWN.
2. IN EACH CUL-DE-SAC, A HYDRANT SHALL BE INSTALLED AT THE BACK EDGE OF PAVEMENT OF THE CUL-DE-SAC
3. INSTALL MAINS ON THE OPPOSITE SIDE OF STREET FROM SANITARY SEWER