




FIRE HYDRANT BOLLARDS

Created: January 1, 2002

Revised: October 30, 2015

Scale: N.T.S.

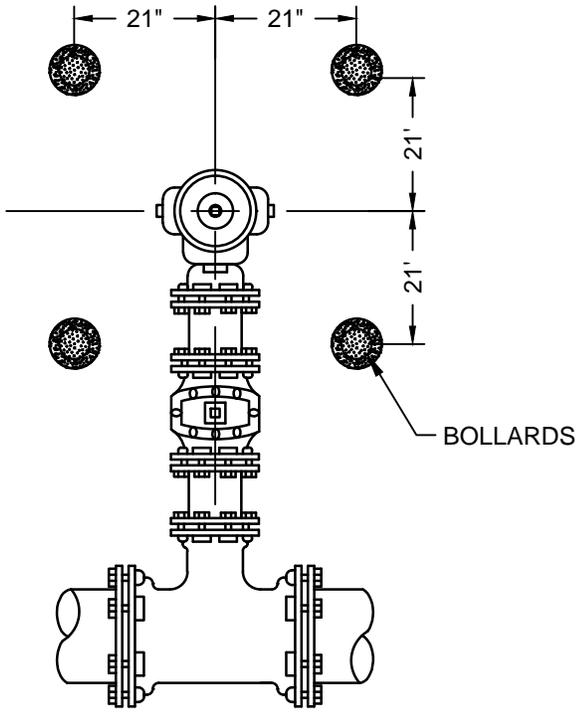


TYPE I, IV & V PLAN VIEW

BOLLARDS TO BE PAINTED
WITH TWO (2) COATS OF
YELLOW SAFETY PAINT


4" SCH. 40 STEEL PIPE,
FILLED WITH CONCRETE

EXISTING GRADE

CONCRETE - 3000 PSI

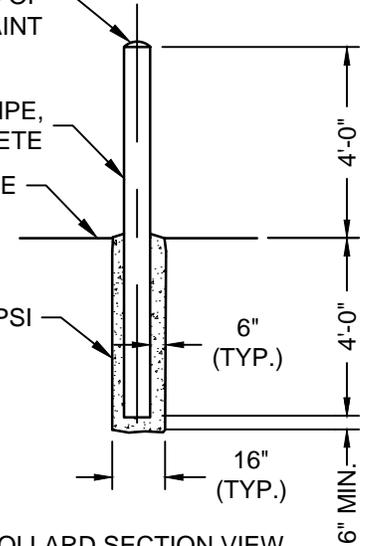

BOLLARD SECTION VIEW

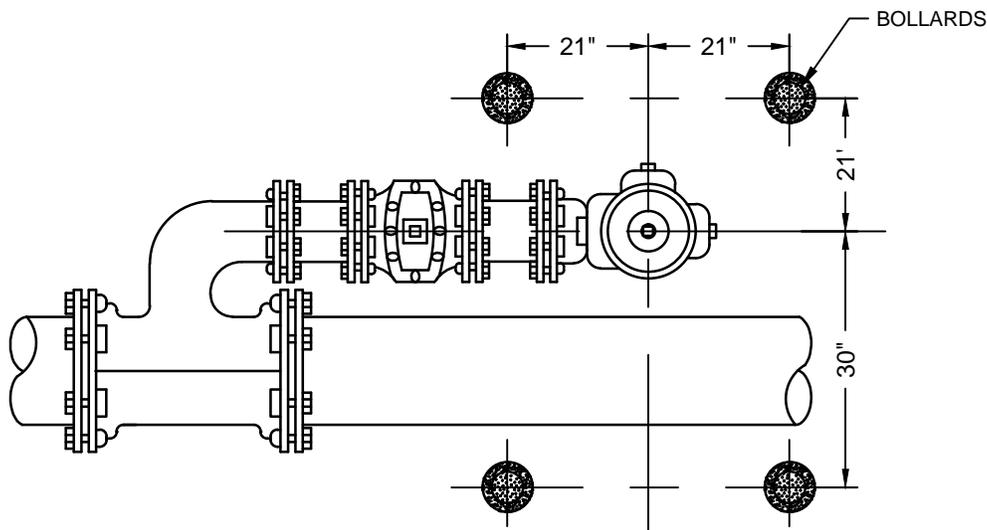

TYPE II, III PLAN VIEW

NOTES:

1. BOLLARDS ON SIDE NOT ACCESSIBLE TO VEHICLES MAY BE OMITTED WITH CITY APPROVAL.
2. CONTRACTOR TO ASSURE THAT BOLLARDS ARE PLACED TO ALLOW FULL ACCESS TO THE PROTECTED FACILITY.