




# LIFT STATION BY-PASS (PORTABLE PUMP CONNECTION)

Created: January 5, 2015


Revised: May 22, 2015

Scale: N.T.S.

Approved: May 22, 2015

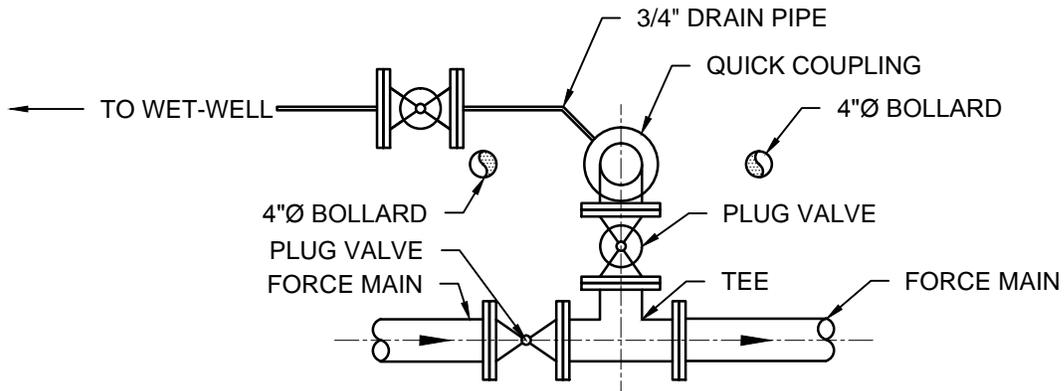

PLAN VIEW

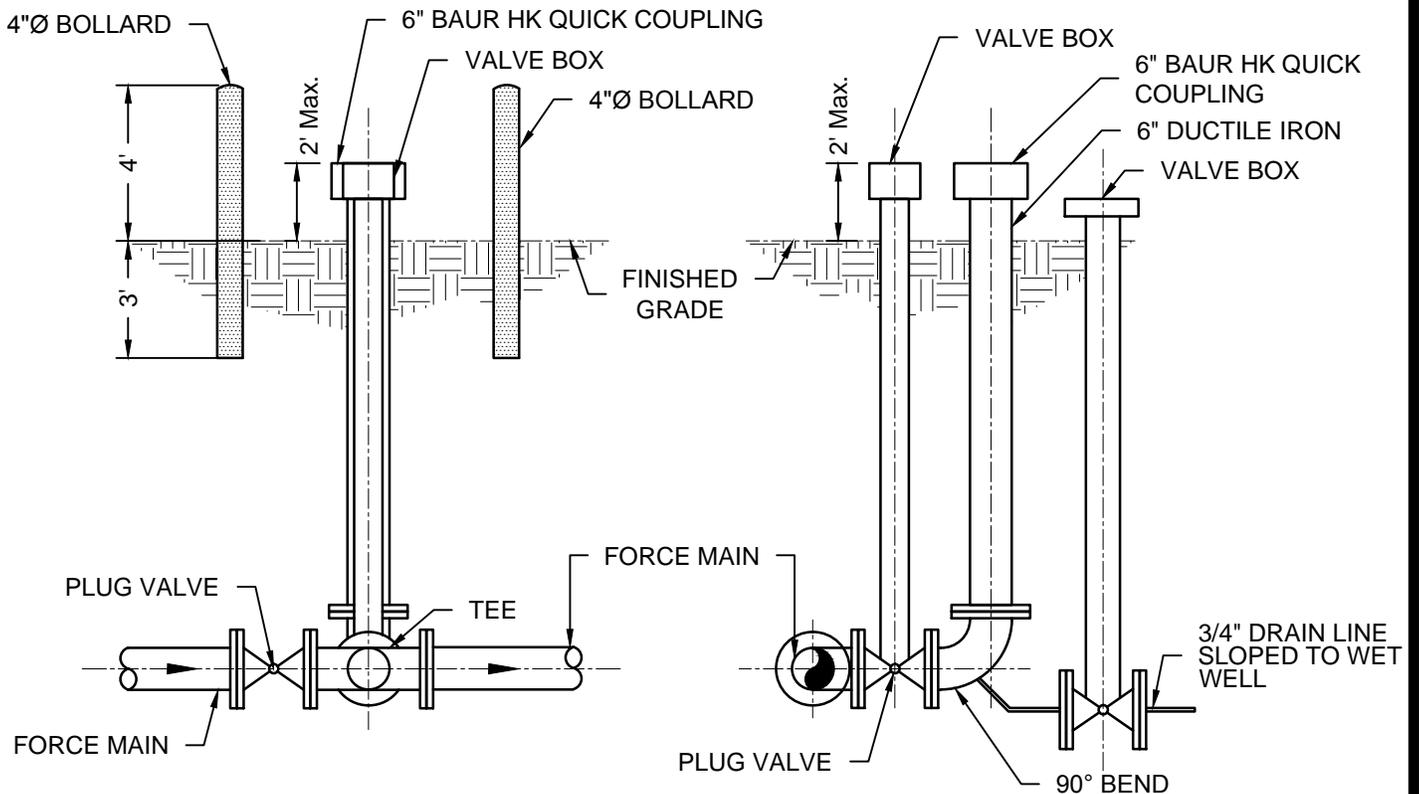

SECTION VIEW

SECTION VIEW

**NOTES:**

1. VALVE BOX SHALL READ "SEWER"
2. ALL BOLLARDS AND PIPING ABOVE GRADE SHALL BE PAINTED SAFETY YELLOW.